
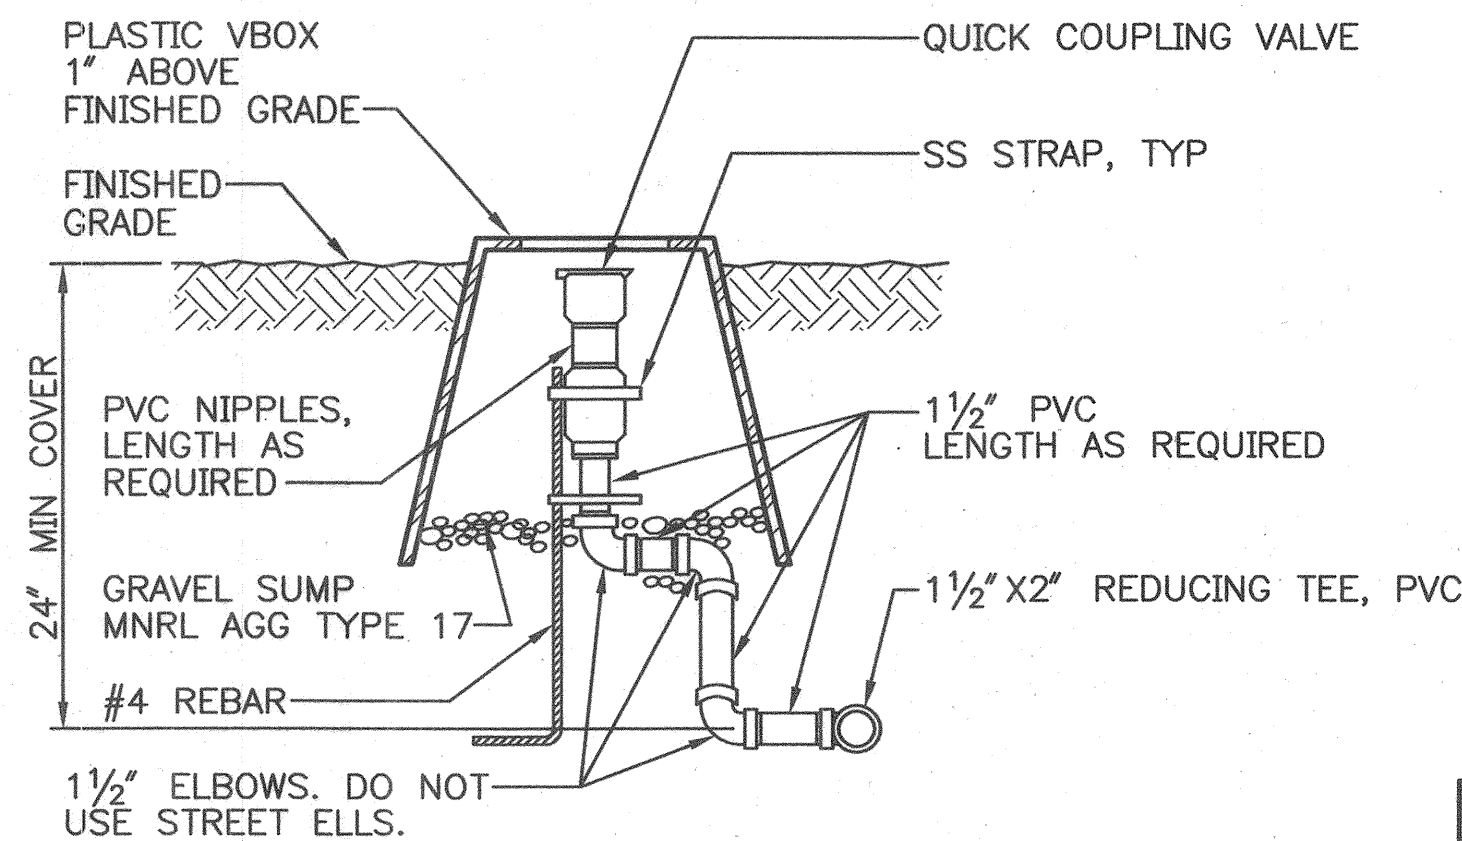
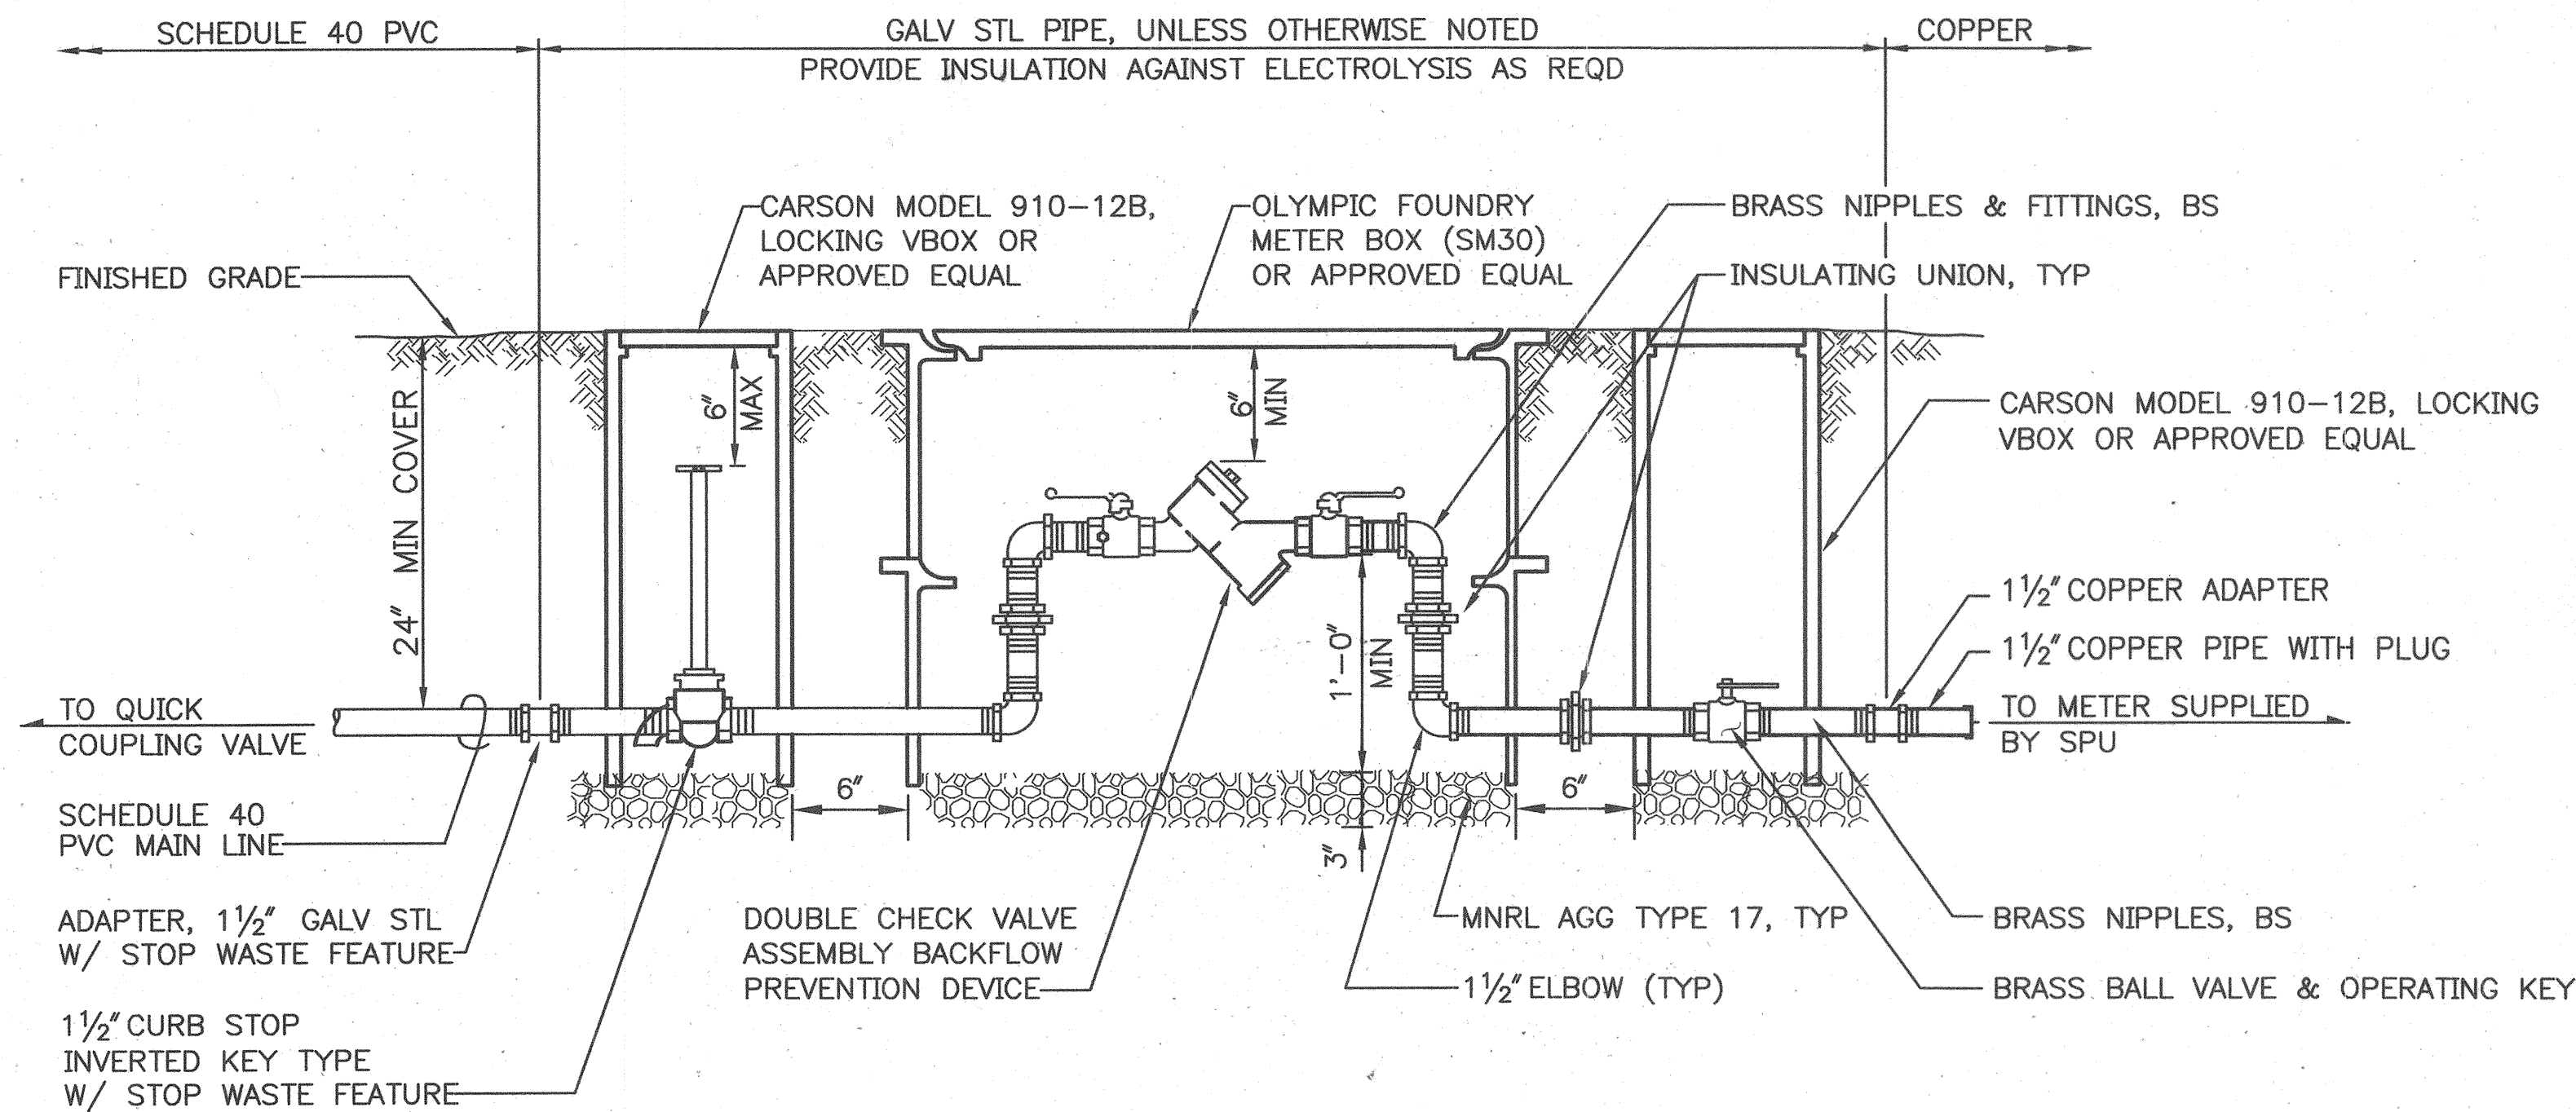
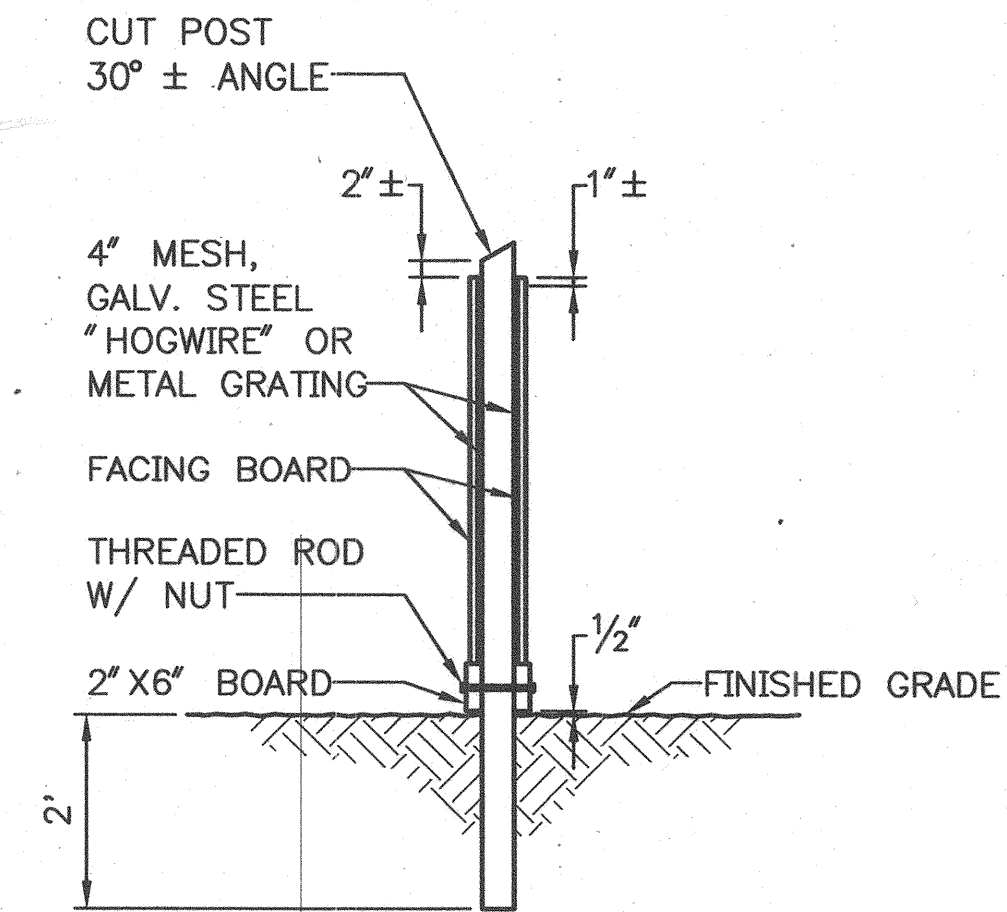


VAULT SERIAL NO.	DATE	MARK	REVISIONS
34213			MADE CHKD REVD

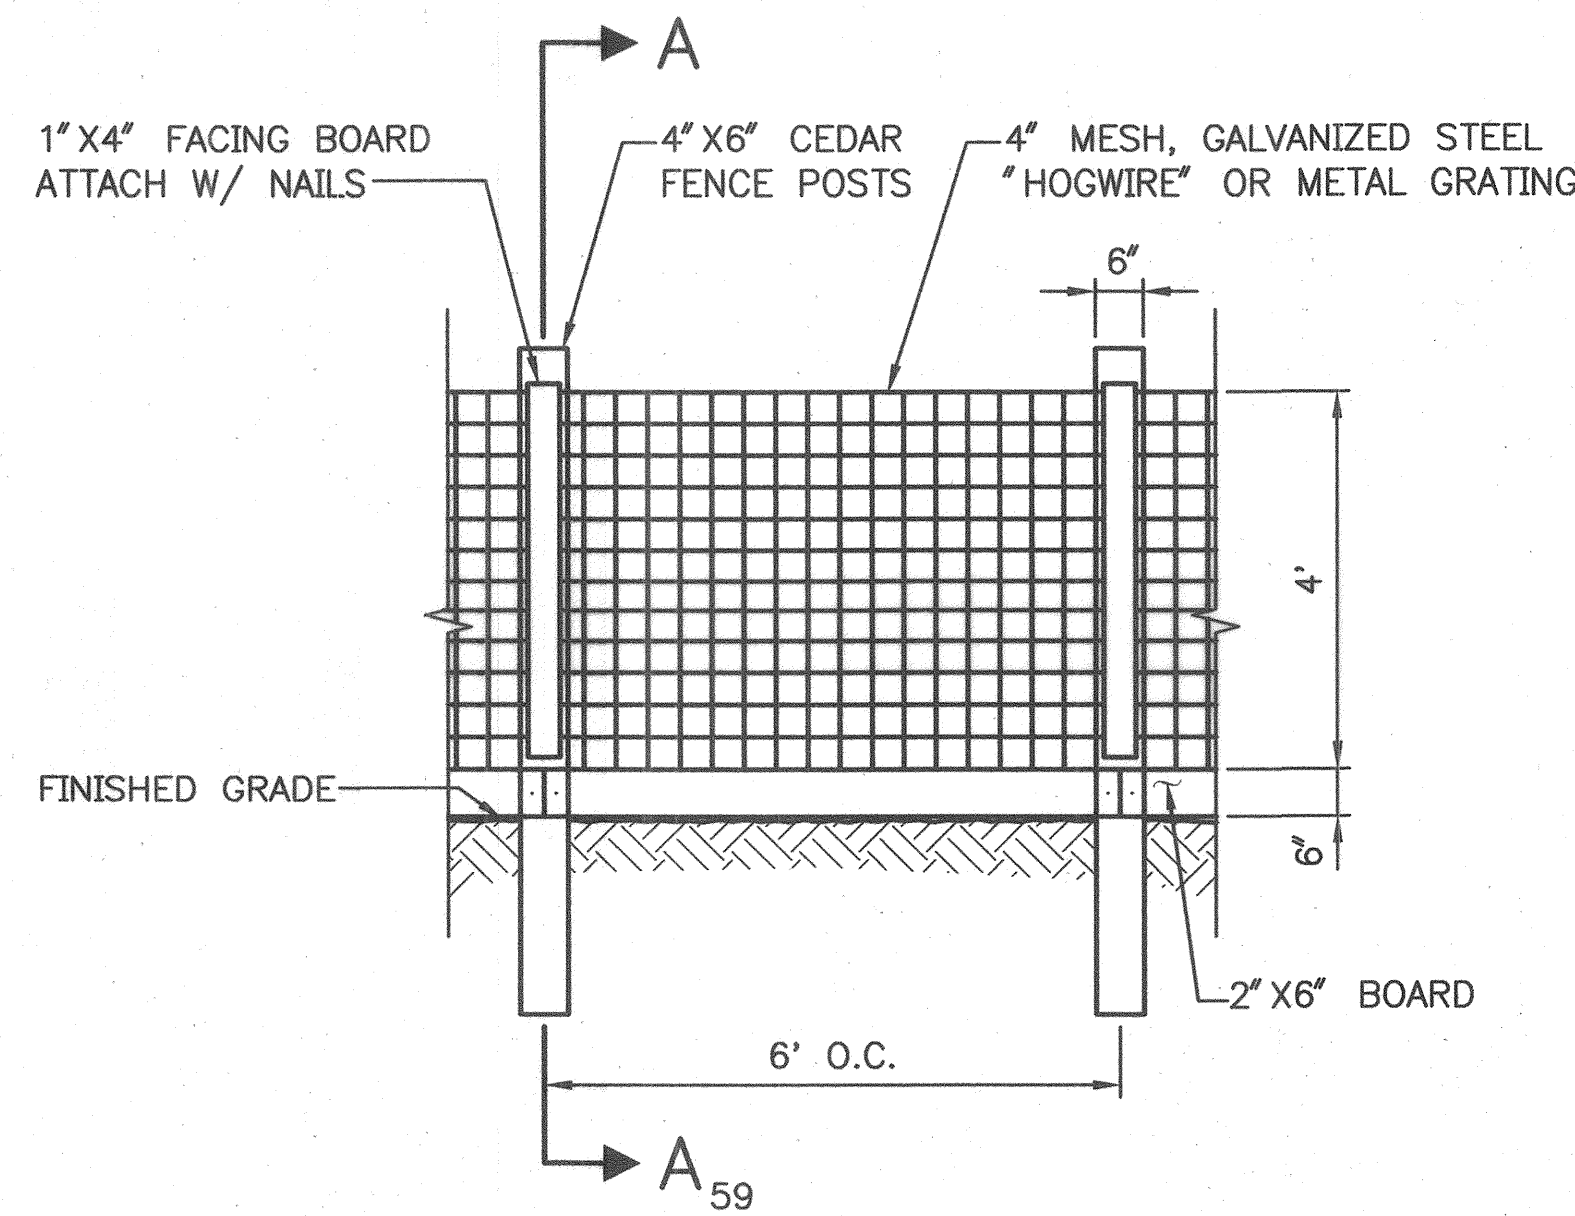

NOTE:

1. THE SYSTEM SHALL HAVE A $\frac{3}{4}$ " WATER METER INSTALLED BY THE CITY, WITH 55 POUNDS STATIC WATER PRESSURE.
2. THE CONTRACTOR SHALL TEST AND MAKE AVAILABLE TEST REPORTS AS REQUIRED.
3. AFTER INSTALLATION COMPLETE CONTACT SPU AT 233-2635 FOR INSPECTION OF BACKFLOW FACILITY.
4. CONTRACTOR SHALL SUPPLY FOUR (4) MINIMUM OF ALL IRRIGATION EQUIPMENT BOX AND VALVE KEYS, AND BRASS HOSE ELLS.

NOTE:

CONTRACTOR SHALL PROVIDE COLORED TACK IN PAVEMENT CLOSEST TO AND OPPOSITE ALL QUICK COUPLING VALVES TO ASSIST WITH FUTURE LOCATING.

IRRIGATION EQUIPMENT INDEX

CATALOG NO.	SYMBOL	MANUFACTURER OR EQUIVALENT; DESCRIPTION
#107005-1"		B&K; 1" BRASS BALL VALVE
805YBV-1"		FEBCO; 1" DOUBLE CHECK VALVE ASSEMBLY
500-1 1/4"		WILKING; 1 1/4" PRESSURE REDUCING VALVE
		1 1/2" STOP AND WASTE VALVE
44NP (1")		RAIN BIRD; 1" QUICK COUPLING VALVE
44K		RAIN BIRD; QUICK COUPLING KEY
SH-1		RAIN BIRD; SWIVEL HOSE ELL (1" x 3/4")

SEE SHEETS 16 & 17
INFRASTRUCTURE NOT REPRESENTED
IN SYMBOL FORM ON PLAN SHALL
BE LOCATED PER FIELD DIRECTION
BY THE ENGINEER.

IRRIGATION DETAILS


APPROVED FOR ADVERTISING
KENNETH J. NAKATSU
DEPARTMENT OF EXECUTIVE ADMINISTRATION
SEATTLE, WASHINGTON 20

BY: DIRECTOR, CONTRACTING SERVICES

NAME OR INITIALS AND DATE
DESIGNED:
CHECKED: 5/20/03
DRAWN: JCS
CHECKED: LMJT

ALL WORK DONE IN ACCORDANCE WITH THE CITY OF SEATTLE STANDARD PLANS AND SPECIFICATIONS AND OTHER DOCUMENTS CALLED FOR IN SECTION 0-02.3 OF THE PROJECT MANUAL.

INITIALS AND DATE
REVIEWED: DES. SDOT. CONST. PROJ. MGR. 5/20/03
RECEIVED
REVISED AS BUILT

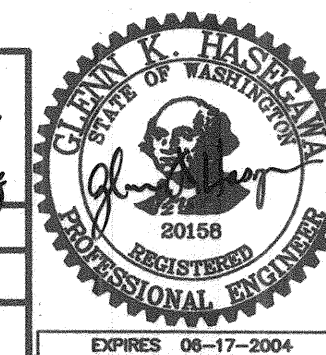

Seattle Public Utilities

ORDINANCE NO.
FUND:
SCALE: NOTED

City of Seattle
Chuck Clarke, Director

APPROVED
INSPECTOR'S BOOK

BROADVIEW GREEN GRID
4TH AVE NW TO PHINNEY AVE N

NO. PC C300329
R/W
CO C300329
VAULT PLAN NO.
777-580
SHEET 59 OF 59